



STATE OF WASHINGTON
DEPARTMENT OF ECOLOGY

Eastern Region Office

4601 North Monroe St., Spokane, WA 99205-1295 • 509-329-3400

August 12, 2024

Chris Napier
CyrusOne LLC – Quincy Data Center
2850 North Harwood Street, Suite 2200
Dallas, TX 75201

Re: **Notice of Construction** - Approval Order No. 24AQ-E036
AQPID: A0250317

Dear Chris Napier:

The Department of Ecology Air Quality Program has reviewed the Notice of Construction application submitted on May 13th, 2024, for the replacement of two previously permitted diesel emergency generators with two same size but newer model number diesel emergency generators at the Quincy facility located at 1025 D Street NW, in Quincy, Washington, Grant County.

Enclosed is the Approval Order No. 24AQ-E036. The 30-day public comment period completed on July 22, 2024. Ecology received one comment about alternative battery backup systems.

All correspondence relating to this document should be directed to me at the Department of Ecology, Regional Air Quality Section, 4601 N. Monroe, Spokane, Washington 99205-1295. If you have any questions concerning the content of the document, please contact me at (509) 329-3528 or Andrew.kruse@ecy.wa.gov.

Sincerely,

Andy Kruse, P.E.
Commercial/Industrial Unit
Air Quality Program
Eastern Regional Office

AK:sg

Enclosures: Approval Order No. 24AQ-E036

Certified Mail: 9214 8901 9403 8372 5906 37



STATE OF WASHINGTON
DEPARTMENT OF ECOLOGY

Eastern Region Office

4601 North Monroe St., Spokane, WA 99205-1295 • 509-329-3400

August 12, 2024

Chris Napier
CyrusOne LLC – Quincy Data Center
2850 North Harwood Street, Suite 2200
Dallas, TX 75201

Re: **Notice of Construction** - Approval Order No. 24AQ-E036
AQPID: A0250317


Dear Chris Napier:

The Department of Ecology Air Quality Program has reviewed the Notice of Construction application submitted on May 13th, 2024, for the replacement of two previously permitted diesel emergency generators with two same size but newer model number diesel emergency generators at the Quincy facility located at 1025 D Street NW, in Quincy, Washington, Grant County.

Enclosed is the Approval Order No. 24AQ-E036. The 30-day public comment period completed on July 22, 2024. Ecology received one comment about alternative battery backup systems.

All correspondence relating to this document should be directed to me at the Department of Ecology, Regional Air Quality Section, 4601 N. Monroe, Spokane, Washington 99205-1295. If you have any questions concerning the content of the document, please contact me at (509) 329-3528 or Andrew.kruse@ecy.wa.gov.

Sincerely,



Andy Kruse, P.E.
Commercial/Industrial Unit
Air Quality Program
Eastern Regional Office

AK:sg

Enclosures: Approval Order No. 24AQ-E036

Certified Mail: 9214 8901 9403 8372 5906 37

State of Washington Department of Ecology
 Notice of Construction Approval Order

In the matter of approving)
 making revision to an existing)
 source for **CyrusOne LLC**)

Approval Order No. **24AQ-E036**
 AQPID No. **A0250317**

Project Summary

CyrusOne – Quincy Data Center, herein referred to as the Permittee, is an existing Data Center located at 1025 D Street NW, Quincy, Washington, in Grant County. The Permittee is classified as a natural minor. The project consists of replacing two previously permitted (but not installed) emergency generators with two units of the same size.

ID	Capacity	Engine SN	Generator SN	Manufacturer Program ID	Build Date
1	2.25 MWe	548104029	95030504016	MTU DS2250 – 16V400084S – 2250kW	Sep-23
2	2.25 MWe	548104051	95030504019	MTU DS2250 – 16V400084S – 2250kW	Sep-23
3	2.25 MWe	548104027	95030504020	MTU DS2250 – 16V400084S – 2250kW	Sep-23
4	2.25 MWe	548104024	95030504180	MTU DS2250 – 16V400084S – 2250kW	Sep-23
5	2.25 MWe	548104070	95030504203	MTU DS2250 – 16V400084S – 2250kW	Sep-23
6	2.25 MWe	548104025	95030504015	MTU DS2250 – 16V400084S – 2250kW	Sep-23
7	2.25 MWe	548104061	95030504014	MTU DS2250 – 16V400084S – 2250kW	Oct-23
8	2.25 MWe	548104072	95030504017	MTU DS2250 – 16V400084S – 2250kW	Oct-23
9	2.25 MWe	548104073	95030504018	MTU DS2250 – 16V400084S – 2250kW	Oct-23
10	2.25 MWe	548104033	95030504274	MTU DS2250 – 16V400084S – 2250kW	Oct-23
11	2.25 MWe	5482001520	95030504276	MTU DS2250 – 16V400084S – 2250kW	Oct-23
12	2.25 MWe	5482001512	95030504273	MTU DS2250 – 16V400084S – 2250kW	Oct-23
13	2.25 MWe	5482001522	95030504407	MTU DS2250 – 16V400084S – 2250kW	Oct-23
14	2.25 MWe	5482001513	95030504408	MTU DS2250 – 16V400084S – 2250kW	Oct-23
15	2.25 MWe	5482001515	95030504409	MTU DS2250 – 16V400084S – 2250kW	Oct-23
16	2.25 MWe	548104069	95030504275	MTU DS2250 – 16V400084S – 2250kW	Nov-23
17	2.25 MWe	548104075	95030504406	MTU DS2250 – 16V400084S – 2250kW	Nov-23
18	2.25 MWe	548104099	95030504272	MTU DS2250 – 16V400084S – 2250kW	Dec-23

ID	Capacity	Engine SN	Generator SN	Manufacturer Program ID	Build Date
19	2.25 MWe	548104211	95030504410	MTU DS2250 – 16V400084S – 2250kW	Jan-24
20	2.25 MWe	548104215	95030504411	MTU DS2250 – 16V400084S – 2250kW	Jan-24
21	2.25 MWe	548104210	95030504412	MTU DS2250 – 16V400084S – 2250kW	Jan-24
22					
23					
24					
25					
26					
27					
28					
29					
30					
31					
32					
33					
34					
35					
36					
37					
38					
39					
40					
41					
42					

Legal Authority

The emissions from the proposed modification have been reviewed under the legal authority of RCW 70A.15.2210 and the applicable rules and regulations adopted thereunder. The proposed modification, if operated as specified, will be in accordance with applicable rules and regulations, as set forth in Chapters 173-400 WAC and 173-460 WAC and the operation thereof, at the location proposed, will not result in ambient air quality standards being exceeded.

This Notice of Construction (NOC) Approval Order rescinds and replaces NOC Approval Order No. 19AQ-E052. NOC Approval Order No. 19AQ-E052 is no longer in effect.

Therefore, it is ordered that the project as described in the NOC application and more specifically detailed in plans, specifications, and other information submitted to the Washington State Department of Ecology (Ecology) is approved for construction and operation, provided the following conditions are satisfied:

Approval Conditions

1. Equipment Restrictions

- a. Any engine used to power the electrical generators must be certified by the manufacturer to meet 40 CFR 60 Tier II emission levels or other more restrictive specifications required by the EPA at the time the engines are installed. Each engine to be installed must be permanently labeled by the manufacturer as an emergency engine in accordance with 40 CFR § 60.4210(f). Each engine approved in this Order must operate as an emergency engine as defined at 40 CFR 60, Subpart IIII or 40 CFR 63, Subpart ZZZZ, and as limited by the other conditions of this approval.
- b. The only engines and electrical generating units approved for operation at the CyrusOne Data Center are those listed by serial number in Table 1.
- c. The installation of any new engines, including replacement of failed engines with identical engines (same manufacturer and model), after 18 months of the issuance date of this permit, will require notification to Ecology that includes engine manufacturer's specification sheets. Ecology will determine whether new source review is required based on various factors including whether the new engines will have either an increased emission rate or result in an emission concentration that may increase impacts over those evaluated for this approval Order, or if an update to the current BACT analysis is necessary.
- d. The 40 MTU Model 16V4000G84S engine exhaust stack heights must be greater than or equal to 35 feet above ground level, and no more than 18 inches in diameter. The remaining two MTU Model 12V1600G71S engines exhaust stack heights must be greater than or equal to 25 feet above ground level, and no more than 10 inches in diameter. CyrusOne Data Center must verify that exhaust stack parameters such as diameter, height, and exhaust rate and velocity do not result in ambient impacts greater than what was evaluated for this project.

- e. This Order only applies to the 40 MTU Model 16V4000G84S engines each with a rated full standby capacity of 2250 kWe, and the 2 MTU Model 12V1600G71S engines, engines with a rated full standby capacity of 750 kWe that were proposed in the Notice of Construction application for this facility approval. On a case-by-case basis, Ecology may require additional ambient impacts analyses prior to installation of engines not listed in Table 1.

2. Operating Limitations

- a. The fuel consumption at the CyrusOne Data Center facility after full build-out and commissioning (a total of 42 engines) must be limited to a total of 252,153 gallons per year of diesel fuel equivalent to on-road specification No. 2 distillate fuel oil (less than 0.00150 weight percent sulfur). Total annual fuel consumption by the facility may be averaged over a three-year period using monthly rolling totals.
- b. The 42 CyrusOne Data Center engines are limited to the following average hours of operation, and averaging periods:
 - i. Except during commissioning, each engine must not exceed 38 hours of operation (at any load, for any purpose) per year, on a rolling monthly three-year average, and averaged over all engines in service.
 - ii. Operation of more than one engine concurrently for more than three hours in any 24-hour period must not occur more than three calendar days in any three-year rolling monthly average period.
 - iii. Operation of more than one engine concurrently must not occur more than nine calendar days in any three-year rolling monthly average period.
 - iv. Operating a single engine at one time, must be limited to 10 hours per day and must operate only between the hours of 7:00 a.m. to 7:00 p.m.
- c. A load bank will be used for electrical energy dissipation whenever prescheduled monthly maintenance testing, corrective testing or annual load bank testing occurs above idle.
- d. The CyrusOne Data Center must develop an operating schedule that must be available for review by Ecology upon request. Changes to the operating schedule will not trigger revision or amendment of this Order if approved in advance by Ecology.
- e. All startup and commissioning testing must be conducted during daylight hours.

3. General Testing and Maintenance Requirements

- a. The CyrusOne Data Center will follow engine-manufacturer's recommended diagnostic testing and maintenance procedures to ensure that each engine will conform to the emission limits in Condition 4 of this approval throughout the life of each engine.

- b. Following installation and commissioning, to demonstrate the engines are commissioned and programmed to run within the Tier 2 emission limits in Condition 4(b), PM (filterable only), NO, NO₂, NMHC, and CO emissions measurement must be conducted for at least one representative engine from each manufacturer and each size engine from each manufacturer of engines installed. Testing must be conducted at the loads of 100 percent, 75 percent, 50 percent, 25 percent, and 10 percent using weighted averaging according to table in Appendix II(a)(1) of 40 CFR 1039. Testing may be conducted using 40 CFR 1065.
- c. Within 60 months of the first engine installation of each phase of installation, and every 60 months thereafter, to demonstrate the engines continue to meet Tier 2 emission limits in Condition 4(b), PM (filterable only), NO, NO₂, NMHC, and CO emissions measurement must be conducted for at least one representative engine from each manufacturer and each size engine from each manufacturer of engines installed. Testing must be conducted at the loads of 100 percent, 75 percent, 50 percent, 25 percent, and 10 percent using weighted averaging according to the table in Appendix II(a)(1) of 40 CFR 1039. Testing may be conducted using 40 CFR 1065. The selection of the engine(s) to be tested must be subject to prior approval by Ecology and must be defined in the source test protocol submitted to Ecology no less than 30 days in advance of any compliance-related stack sampling conducted by CyrusOne. Each engine tested must be the engine from each batch (same manufacturer and size) of engines installed with the most operating hours not previously tested.
- d. The following procedures must be used for each test for the engines required by Approval Condition 3(b) and 3(c) unless an alternate method is proposed by the CyrusOne Data Center and approved in writing by Ecology prior to the test:
 - a. Initial and periodic emissions stack testing should be combined with other pre-scheduled maintenance testing and annual load bank engine testing. Additional operation of the engines for the purpose of emissions testing beyond the operating hours allowed in this Order must be approved by Ecology in writing.
 - b. The F-factor method, as described in EPA Method 19, may be used to calculate exhaust flow rate through the exhaust stack. The fuel meter data, as measured according to Approval Condition 3(f), must be included in the test report, along with the emissions calculations.
 - c. In the event that any stack test indicates non-compliance with the emission limits in Condition 4, CyrusOne must repair or replace the engine and repeat the test on the same engine plus two additional engines from the same phase of installation as the engine showing non-compliance. Test reports must be submitted to Ecology within 60 days of the final day of testing. Test reports must be submitted to the address in Condition 8(a) and must report units and

averaging periods consistent with the applicable emission standard or limit listed in Condition 4(b).

- e. Each engine must be equipped with a properly installed and maintained non-resettable meter that records total operating hours.
- f. Each engine must be connected to a properly installed and maintained fuel flow monitoring system that records or calculates the amount of fuel consumed by that engine. The fuel monitoring system may consist of:
 - i. a fuel meter incorporated into each engine control module; or
 - ii. a system that calculates fuel consumption based on the maximum engine load measured during each run, using manufacturer-provided load-based fuel consumption rates.

4. Emission Limits

- a. The 42 engines must meet the emission rate limitations contained in this section. The limits are for an engine operating in a steady-state mode (warm) and do not include emission rates during initial commissioning testing of the engines. The annual limits may be averaged over a rolling monthly three-year period. Unless otherwise approved by Ecology in writing, compliance with emission limits for those pollutants that are required to be tested under Approval Conditions 3(b) and 3(c) must be based on emissions test data determined according to those approval conditions.
- b. To demonstrate compliance with the g/kW-hr EPA Tier II average emission limits through stack testing, the CyrusOne Data Center must conduct exhaust stack testing and averaging of emission rates for five individual operating loads (10 percent, 25 percent, 50 percent, 75 percent, and 100 percent) according to the table in Appendix II(a)(1) of 40 CFR 1039, and/or 40 CFR Part 60, Subpart IIII, or any other applicable EPA requirement in effect at the time the engines are installed. The Tier 2 emission limits for the 42 engine generators:
 - i. NMHC + NO_x: 6.4 g/kW-hr
 - ii. CO: 3.5 g/kW-hr
 - iii. PM (filterable): 0.20 g/kw-hr
- c. The facility must meet the following emission rate limitations.
 - i. Diesel Engine Exhaust Particulate (DEEP: filterable only) emissions from all 42 engines must not exceed 0.62 tons per year averaged over a rolling monthly three-year period.
 - ii. Total Particulate Matter (PM=PM_{2.5}) emissions from all 42 engines combined must not exceed 2.3 tons/yr averaged over a rolling monthly three-year period.

- iii. Nitrogen Oxides emissions from all 42 engines combined must not exceed 36 tons per year averaged over a rolling monthly three-year period.
- iv. Nitrogen dioxide (NO₂) emissions from all 42 engines combined must not exceed 3.6 tons/yr averaged over a rolling monthly three-year period.
- v. Volatile organic compound (VOC) emissions from all 42 engines combined must not exceed 1.8 tons/yr averaged over a rolling monthly three-year period.
- vi. Carbon Monoxide (CO) emissions from all 42 engines combined must not exceed 7.9 tons/yr averaged over a rolling monthly three-year period.
- vii. Sulfur dioxide emissions from all 42 engines combined must not exceed 0.027 tons/yr averaged over a rolling monthly three-year period.
- viii. Visual emissions from each diesel electric generator exhaust stack must be no more than five percent, with the exception of a five-minute period after unit start-up. Visual emissions must be measured by using the procedures contained in 40 CFR 60, Appendix A, Method 9.

5. Operation and Maintenance

- a. The Permittee must follow all recommended installation, configuration, operation, and maintenance provisions supplied by emission unit and component manufacturers.
- b. An operations and maintenance (O&M) manual must be updated by the Permittee for each emission unit. The manufacturer's instructions may be referenced in the O&M manual.
 - i. The O&M manual must include the following, at a minimum:
 - A. Manufacturer's testing and maintenance procedures that will ensure that each individual engine will conform to the EPA Tier Emission Standards appropriate for that engine throughout the life of the engine.
 - B. Normal operating parameters for emissions units.
 - C. A maintenance schedule for each emissions unit.
 - D. A description of the monitoring procedures.
 - E. Monitoring and record keeping requirements.
 - F. Actions for abnormal control system operation.
 - ii. The O&M manual must be updated within 30 days of commencing operation of each emission unit.
- c. Emission units must be operated and maintained in accordance with the O&M manual.

- d. The Permittee must assess all complaints received. The Permittee must initiate corrective action in response to a complaint within three calendar days of receipt of the complaint.

6. Monitoring and Recordkeeping

- a. The O&M manual must be reviewed annually.
 - i. The date of each review and the person performing each review must be documented in the O&M manual.
 - ii. The O&M manual must be updated to reflect any modifications to emission units or operating procedures.
- b. O&M records must be kept on premises in hard copy or readily available on-site electronically.
- c. For all air-quality related complaints, the following records must be kept:
 - i. A written record of the complaint received by the Permittee or forwarded to the Permittee.
 - ii. The Permittee's action to investigate the validity of the complaint, any corrective action that was taken in response to the complaint, and the effectiveness of the remedial action.
- d. The date, time, duration, and cause of any periods where control technology equipment is out of service must be documented and maintained.
- e. All data required by this NOC Approval Order must be maintained in a readily retrievable manner for a period of five years and must be made available to authorized representatives of Ecology upon request.
- f. The Permittee must complete any additional monitoring or recordkeeping necessary to determine compliance with the requirements of this NOC Approval Order, as determined by Ecology.
- g. The following records are required to be collected and maintained:
 - i. Fuel receipts with amount of diesel and sulfur content for each delivery to the facility.
 - ii. Monthly and annual hours of operation for each diesel engine.
 - iii. Purpose, electrical load, and duration of runtime for each diesel engine during any periods of operation.
 - iv. Annual gross power generated by or for each independent tenant at the facility and total annual gross power generated by the facility.
 - v. Upset condition log for each engine and generator that includes date, time, duration of upset, cause, and corrective action.

- vi. Air quality complaints received from the public or other entity, and the affected emissions units.
- h. The number of hours each engine has run, the fuel consumed, and the date must be recorded. Data must be provided to Ecology on request.

7. Testing Plan Requirements

- a. The Permittee must submit a test plan to Ecology for review and approval at least 30 days prior to source testing. Ecology may require a new protocol for re-test events conducted after a failed source test, when required, and Ecology may approve a shorter timeframe for submission for the re-test protocol. The test plan must include the following information, at a minimum:
 - i. Identification of each emission unit to be tested.
 - ii. The operating parameters to be monitored during the test.
 - iii. A description of the emission units to be tested.
 - iv. The time and date of the proposed source test.
 - v. Identification and qualifications of the source test personnel.
 - vi. A description of the test methods and procedures to be used.
- b. Test reports must be submitted to Ecology within 60 days of completion of the source testing. Test reports must include the following information, at a minimum:
 - i. The information described under Approval Conditions 3 and 7(a).
 - ii. The information described in the test plan and any subsequent test plan approval letters.
 - iii. Field and analytical laboratory data.
 - iv. Quality assurance/quality control procedures and documentation.
 - v. Analyzer data recorded during the test.
 - vi. A summary of results, reported in units and averaging periods consistent with the applicable emission limit.
 - vii. A summary of control system and equipment operating conditions.
 - viii. Copies of all field data.
 - ix. Chain of custody information.
 - x. Calibration documentation.
 - xi. Discussion of any abnormalities associated with the results.
 - xii. A statement signed by the senior management official of the testing firm certifying the validity of the source test report.

- xiii. Emission calculations.
- c. The Permittee must provide adequate sampling ports, safe sampling platforms, and access to platforms and utilities for sampling and testing, in accordance with 40 C.F.R. 60.8, 40 C.F.R. 63.7(d), and WAC 173-400-105(4).
- d. When information obtained by Ecology indicates the need to quantify emissions, Ecology may require the Permittee to conduct material analysis or air emission testing under WAC 173-400-105. This testing requirement is in addition to any testing required by Ecology in this NOC Approval Order, other permits, or other state or federal requirements.
- e. Alternate test methods and procedures may be proposed by the Permittee for Ecology review; a justification for the change must be included. Proposed alternates must not be utilized unless an approval is issued by Ecology, in writing, prior to the test.

8. Reporting

- a. All notifications, plans, reports, and other submittals must be submitted in a manner approved by Ecology.

Washington State Department of Ecology
Air Quality Program
4601 N. Monroe Street
Spokane, WA 99205-1295

Reports may also be submitted electronically to: ecyaqciero@ecy.wa.gov

Or as directed.

- b. Within 10 business days after entering into a binding agreement with a new tenant, CyrusOne must notify Ecology of such agreement. The serial number, manufacturer make and model, standby capacity, and date of manufacture of engines proposed will be submitted prior to installation of engines in any of the phases of this project.
- c. The following information will be submitted to the AQP at the address in Condition 8(a) above by January 31 of each calendar year. This information may be submitted with annual emissions information requested by the AQP.
 - i. Monthly rolling annual total summary of air contaminant emissions.
 - ii. Monthly rolling hours of operation for each engine with annual total.
 - iii. Monthly rolling gross power generation with annual total as specified in Approval Condition 6(vi).
 - iv. A log of each start-up of each diesel engine that shows the date, the purpose, fuel usage, and duration of each period of operation.

- d. Any air quality complaints resulting from operation of the emissions units or activities must be promptly assessed and addressed. CyrusOne must maintain a record of the action taken to investigate the validity of the complaint and what, if any, corrective action was taken in response to the complaint. Ecology must be notified within three days of receipt of any such complaint.
- e. CyrusOne must notify Ecology by e-mail or in writing within 24 hours of any engine operation of greater than 60 minutes if such engine operation occurs as the result of a power outage or other unscheduled operation. This notification does not alleviate CyrusOne from annual reporting of operations contained in any section of Approval Condition 8.
- f. The Permittee must notify Ecology within 30 days of the following events:
 - i. Commencement of construction of the project.
 - ii. Completion of the construction of the project.
 - iii. If construction or operation has been discontinued for more than 18 months.
- g. The Permittee must notify Ecology within 60 days (or longer as approved by Ecology) of the following events:
 - i. Changes in operation contrary to information submitted in the NOC application.
 - ii. Discontinued operations. This notification must include a shutdown status maintenance plan containing the following information, at a minimum:
 - A. Maintenance that will be performed during the shutdown to allow startup in a timely manner with minimum amount of work and emissions, (allowable emission levels as of the date of shutdown cannot increase upon reopening).
 - iii. Reactivating the facility following discontinued operations of 18 months or more. This notification must include a start-up plan containing the following information, at a minimum:
 - A. Documentation that the shutdown maintenance was performed during shutdown to allow startup in a timely manner with minimum amount of work and emissions (allowable emissions levels as of the date of shutdown cannot increase upon reopening).
 - B. Documentation of testing performed which demonstrates that units are still able to meet the parameters of this approval order after being inactive, or other documentation which demonstrates why testing is not necessary.

9. General Conditions

- a. **Activities Inconsistent with this Order** - Any activity undertaken by the Permittee, or others, in a manner that is inconsistent with the data and specifications submitted as part of the NOC application or this NOC Approval Order, must be subject to Ecology enforcement under applicable regulations.
- b. **Availability of Order** - Legible copies of this NOC Approval Order and any O&M manual(s) must be available to employees in direct operation of the equipment described in the NOC application and must be available for review upon request by Ecology.
- c. **Compliance Assurance Access** - Access to the source by representatives of Ecology or the United States Environmental Protection Agency (EPA) must be permitted upon request. Failure to allow access is grounds for enforcement action under the federal Clean Air Act or the Washington State Clean Air Act and may result in revocation of this NOC Approval Order.
- d. **Discontinuing Construction** - Approval to construct or modify a stationary source becomes invalid if construction is not commenced within eighteen months after receipt of the approval, or if construction is discontinued for a period of eighteen months or more. The permitting authority may extend the 18-month period upon a satisfactory showing by the permittee that an extension is justified.
- e. **Equipment Operation** - Operation of the facility must be conducted in compliance with all data and specifications submitted as part of the NOC application and in accordance with O&M manuals, unless otherwise approved in writing by Ecology.
- f. **Registration** - Periodic emissions inventory and other information may be requested by Ecology. The requested information must be submitted within 30 days of receiving the request, unless otherwise specified. All fees must be paid by the date specified.
- g. **Violation Duration** - If the Permittee violates an approval condition in this NOC Approval Order, testing, recordkeeping, monitoring, or credible evidence will be used to establish the starting date of the violation. The violation will be presumed to continue until testing, recordkeeping, monitoring, or other credible evidence indicates compliance. A violation of an approval condition includes, but is not limited to, failure of air pollution control equipment, failure of other equipment resulting in increased emissions, or a failed source test indicating an exceedance of an emission limit.
- h. **Odor** - The Permittee must not cause or allow the generation of any odor which unreasonably interferes with any other property owner's use and enjoyment of their property. The Permittee must use recognized good practice and procedures to reduce odors to a reasonable minimum.

- i. **Obligations Under Other Laws or Regulations** - Nothing in this NOC Approval Order must be construed so as to relieve the Permittee of its obligations under any state, local, or federal laws or regulations.
- j. **Maintaining Compliance** - It must not be a defense for the Permittee in an enforcement action that it would have been necessary to halt or reduce the operations in order to maintain compliance with the conditions of this NOC Approval Order.
- k. **Visible Emissions** - No visible emissions from the source are allowed beyond the property line, as determined by 40 C.F.R. Part 60, Appendix A, Test Method 22.
- l. **Changes in Operations** - Changes in operation, discontinued operation, or inadequate maintenance plans or re-start plans (see “Reporting” requirements), may require a new or amended NOC Approval Order.

Authorization may be modified, suspended, or revoked in whole or part for cause, including, but not limited to, the following:

- Violation of any terms or conditions of this authorization.
- Obtaining this authorization by misrepresentation or failure to disclose all relevant facts.

The provisions of this authorization are severable and, if any provision of this authorization or application of any provision to any circumstance is held invalid, the application of such provision to other circumstances, and the remainder of this authorization, must not be affected thereby.

Your Right to Appeal

You have a right to appeal this NOC Approval Order to the Pollution Control Hearings Board (PCHB) within 30 days of the date of receipt of this NOC Approval Order. The appeal process is governed by Chapter 43.21B RCW and Chapter 371-08 WAC. “Date of receipt” is defined in RCW 43.21B.001(2).

To appeal you must do all of the following within 30 days of the date of receipt of this NOC Approval Order:

- File your appeal and a copy of this NOC Approval Order with the PCHB (see addresses below). Filing means actual receipt by the PCHB during regular business hours.
- Serve a copy of your appeal and this NOC Approval Order on Ecology in paper form - by mail or in person (see addresses below). E-mail is not accepted.

You must also comply with other applicable requirements in Chapter 43.21B RCW and Chapter 371-08 WAC.

Address and Location Information

Filing with the PCHB

For the most current information regarding filing with the PCHB, visit: <https://eluh0.wa.gov/>
or call: 360-664-9160.

Service on Ecology

Street Addresses:

Department of Ecology
Attn: Appeals Processing Desk
300 Desmond Drive SE
Lacey, WA 98503

Mailing Addresses:

Department of Ecology
Attn: Appeals Processing Desk
PO Box 47608
Olympia, WA 98504-7608

E-Mail Address:

ecologyappeals@ecy.wa.gov

Americans with Disabilities Act Information

Accommodation Requests

To request ADA accommodation including materials in a format for the visually impaired, call Ecology at 360-407-7668 or visit <https://ecology.wa.gov/accessibility>. People with impaired hearing may call Washington Relay Service at 711. People with speech disability may call TTY at 877-833-6341.

Dated on this 12th Day of August, 2024.

Prepared by:

Andrew Kruse, PE
Air Quality Program
Department of Ecology
State of Washington

Approved by:

Karin Baldwin, Section Manager
Air Quality Program, Eastern Region
Department of Ecology
State of Washington

Address and Location Information

Filing with the PCHB

For the most current information regarding filing with the PCHB, visit: <https://eluh0.wa.gov/>
or call: 360-664-9160.

Service on Ecology

Street Addresses:

Department of Ecology
Attn: Appeals Processing Desk
300 Desmond Drive SE
Lacey, WA 98503

Mailing Addresses:

Department of Ecology
Attn: Appeals Processing Desk
PO Box 47608
Olympia, WA 98504-7608

E-Mail Address:

ecologyappeals@ecy.wa.gov

Americans with Disabilities Act Information


Accommodation Requests

To request ADA accommodation including materials in a format for the visually impaired, call Ecology at 360-407-7668 or visit <https://ecology.wa.gov/accessibility>. People with impaired hearing may call Washington Relay Service at 711. People with speech disability may call TTY at 877-833-6341.

Dated on this 12th Day of August, 2024.

Prepared by:

Andrew Kruse, PE
Air Quality Program
Department of Ecology
State of Washington

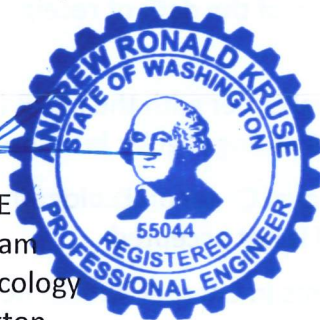

Approved by:

Karin Baldwin, Section Manager
Air Quality Program, Eastern Region
Department of Ecology
State of Washington

**Technical Support Document
For Approval Order No. 24AQ-E036
CYRUSONE Data Center
Quincy, WA**

1. Project Description

On May 13th, 2024, Ecology received a Notice of Construction application submitted by Ramboll on behalf of CyrusOne LLC. CyrusOne, the permittee, requested approval to replace the previously approved (but never purchased or installed due to construction delays) two 750kW emergency generators (for the administrative building) with two of the same size and output generators from the same manufacturer (MTU) since the previously approved generators are no longer available. These two previously approved generators are replaced with a newer model. It was discovered that the emissions from the two new generators are not the exact same, with some slightly higher and some slightly lower, but overall, the emission changes appear to be negligible. Modeling was conducted by Ramboll just to prove out the new generators are extremely close; the results confirmed the emission change is negligible. The other 40 emergency generators previously permitted for the data center remain unchanged.

The full modeling report and emission info can be found in the NOC Application, but the two tables below show the differences between the previously permitted generators and these two new proposed units. Below is Table 1 and Table 2 from the NOC Application.

Comparison of Annual Potential Emissions; Table 1 and 2 from the NOC Application

Pollutant	Previous Model (tpy)	Proposed Model (tpy)	Change due to Engine Update (tpy)
NOx	0.60	0.54	-0.067
Carbon monoxide (CO)	0.082	0.088	0.0063
SO2	4.7E-04	4.1E-04	-5.4E-05
PM	0.023	0.046	0.024
Nitrogen dioxide (NO2)	0.060	0.054	-0.0067
Diesel engine exhaust particulate (DEEP)	0.0049	0.0054	0.00050

Modeled Cumulative Impacts Compared to Air Quality Standards and Previous Values

Pollutant and Averaging Period	NAAQS (ug/m ³)	Modeled Operating Scenario	Concentration (ug/m ³)			
			2024 Modeled Project	2024 Regional Background	2024 Cumulative	2018 Cumulative
PM10 24-hour	150	3-hour power outage (2 nd day)	74.6	61	136	147
PM2.5 Annual	12/9 ²	Theoretical Max. Year	2.4	5.4	7.8	9.4
CO 1-hour	40,000	Unplanned power outage	6,947	1,321	8,268	13,266
CO 8-hour	10,000	Unplanned power outage	4,770	923	5,693	8,196

On January 3, 2019, Ecology received a hardcopy of a Notice of Construction (NOC) application submittal from CyrusOne LLC (CyrusOne). CyrusOne, the permittee, requesting approval for a permit application for a new facility named the CyrusOne Data Center to be located in Quincy, Washington. The NOC application was considered complete on January 28, 2019. Ecology requested additional information explaining the conservative assumptions used in the application with respect to NO₂ and NAAQS, which CyrusOne provided to Ecology on February 19, 2019. Ecology considers this additional information as part of the application. A public comment period was held from May 9, 2019, through June 17, 2019, with a public hearing on June 13, 2019. One person provided public testimony and submitted comments. The response to comments is located at the end of this technical support document.

The CyrusOne Data Center complex will be located on Grant County Parcel No. 040411075, at 1025 NW D Street, Quincy, Washington. The following information comprises the legal description of the facility provided by the applicant:

THAT PORTION OF FARM UNIT 186 IRRIGATION BLOCK 73, COLUMBIA BASIN PROJECTION IN THE NORTHWEST QUARTER OF SECTION 7, TOWNSHIP 20 NORTH, RANGE 24 E.W.M., GRANT COUNTY, WASHINGTON, DESCRIBED AS FOLLOWS;BEGINNING AT THE WEST QUARTER CORNER OF SAID SECTION; THENCE NORTH 89°57'58" EAST, FOLLOWING THE EAST-WEST MIDSECTION LINE OF SAID SECTION AND THE SOUTH BOUNDARY OF FARM UNIT 187, IRRIGATION BLOCK 73,

719.00 FEET, TO THE SOUTHWEST CORNER OF FARM UNIT 186 AND THE TRUE POINT OF BEGINNING; THENCE NORTH 89°57'58"EAST, FOLLOWING THE SOUTH BOUNDARY OF SAID FARM UNIT 186, 1166.19 FEET; THENCE NORTH 00°01'04"WEST, 1929.25 FEET, TO AN INTERSECTION WITH THE NORTH BOUNDARY OF SAID FARM UNIT 186 AND A POINT ON A CURVE THE CENTER OF WHICH BEARS NORTH 08°35'44"WEST; THENCE FOLLOWING THE BOUNDARIES OF SAID FARM UNIT 186 THROUGH THE FOLLOWING SEVEN (7) COURSES, GOING WESTERLY FOLLOWING SAID CURVE TO THE RIGHT HAVING A CENTRAL ANGLE OF 07°58'44" A RADIUS OF 286.48 FEET AND AN ARC LENGTH OF 39.90 FEET; THENCE SOUTH 89°23'00"WEST, 185.45 FEET; THENCE WESTERLY FOLLOWING A TANGENTIAL CURVE TO THE LEFT HAVING A CENTRAL ANGLE OF 19°03'00" A RADIUS OF 286.48 FEET AND AN ARC LENGTH OF 95.25 FEET; THENCE SOUTH 70°20'00"WEST, 428.53 FEET; THENCE SOUTHWESTERLY FOLLOWING A TANGENTIAL CURVE TO THE LEFT HAVING A CENTRAL ANGLE OF 07°09'00" A RADIUS OF 572.96 FEET AND AN ARC LENGTH OF 71.50 FEET; THENCE SOUTH 63°11'00"WEST, 423.44 FEET, TO THE NORTHWEST CORNER OF SAID FARM UNIT 186; THENCE SOUTH 00°00'00"EAST, 1544.60 FEET, TO THE TRUE POINT OF BEGINNING.

The CyrusOne Data Center will contain 42 emergency engines to support two main buildings but will be located in enclosures separate from the buildings. The emergency engines proposed in the application will be powered by diesel and may be referred to in this TSD as “diesel engine-generator sets”, “engine-generator sets,” “engine” or “generator,” depending on the context of each TSD section.

The 40 engine-generator sets proposed in the application are MTU Model 16V4000G84S, each with a rated capacity of 2.25 megawatt electrical (MWe) units, and the other two are MTU Model 12V2000G85-TB, each with a rated capacity of 0.750 MWe. If the facility is fully built-out as planned, it will have a combined capacity of up to approximately 91.5 MWe.

CyrusOne will use direct evaporative cooling units to cool the data server areas. According to the application, the cooling units are not a source of air emissions. In addition, the facility claims it *“will not install any other diesel engines for use as fire pumps or for life-safety purposes.”*

1.1. Potential to Emit for Criteria Pollutants and Toxic Air Pollutants (TAPs)

Because emissions of any single criteria pollutant are less than 100 tons per year, and because emissions of any single hazardous air pollutant (HAP) are less than 10 tpy (and less than 25 tpy for combined HAPs), a Title V major permit is not required. Because emissions are less than Title I New Source Review (NSR) major levels (100 tpy for listed sources on page A-11 of the 1990 NSR Workshop Manual, but 250 tpy for all other sources such as data centers), a prevention of significant deterioration (PSD) air permit is also not required. Also, because Quincy is in attainment for all pollutants, an NSR nonattainment permit is not required. For this project, a Title I NSR minor permit is required. In order to stay below the potential to emit (PTE) emissions levels listed in the permit, the permit requires that each engine meet the emission requirements of EPA Tier 2 engines. Table 1 contains the PTE estimates for project criteria pollutants and toxic air pollutants (TAPs).

Table 1. Potential-To-Emit Estimates for Criteria Pollutants* and Toxic Air Pollutants (TAPs)**

Pollutant	Emission Factor Units = g/kW-hr (except where noted)	PTE (TPY) Avg	References
*NO _x	8.5 (2.25 MWe engines); 8.10 (0.75 MWe engines)	36	(b),(e)
NO ₂ **	0.85 (2.25 MWe engines); 0.81 (0.75 MWe engines); 10% of NO _x	3.6	(b)
*CO**	1.7 (2.25 MWe engines); 1.0 (0.75 MWe engines)	7.9	(b)
*PM _{2.5} /PM ₁₀	2.9 lb/hr (2.25 MWe engines); 0.57 lb/hr (0.75 MWe engines)	2.3	(b)
*VOC	1.6 (2.25 MWe engines); 0.91 (0.75 MWe engines)	1.8	(a),(b),(e)
*SO ₂ **	15 ppm	0.027	(c)
*Lead**	NA	Negligible	(d)
*Ozone**	NA	NA	(e)
Diesel Engine Exhaust, Particulate (DEEP)**	0.19 (2.25 MWe engines); 0.25 (0.75 MWe engines);	0.62	(b),(g)
Propylene**	2.8E-03 lb/MMBTU	5.0E-02	(h)
Benzene**	7.8E-04 lb/MMBTU	1.4E-02	(h)
Xylenes**	1.9E-04 lb/MMBTU	3.5E-03	(h)
Napthalene**	1.3E-04 lb/MMBTU	2.3E-03	(h)
Formaldehyde**	7.9E-05 lb/MMBTU	1.4E-03	(h)
1,3 Butadiene**	3.9E-05 lb/MMBTU	7.0E-04	(h)
Acrolein**	7.9E-06 lb/MMBTU	1.4E-04	(h)

Pollutant	Emission Factor Units = g/kW-hr (except where noted)	PTE (TPY) Avg	References
Acetaldehyde**	2.5E-05 lb/MMBTU	4.5E-04	(h)
Benzo(a)anthracene**	6.2E-07 lb/MMBTU	1.1E-05	(h)
Benzo(b)fluoranthene**	1.1E-06 lb/MMBTU	2.0E-05	(h)
Dibenz(a,h)anthracene**	3.5E-07 lb/MMBTU	6.2E-06	(h)
Benzo(a)Pyrene**	2.6E-07 lb/MMBTU	4.6E-06	(h)
Toluene**	2.8E-04 lb/MMBTU	5.5E-03	(h)
Chrysene**	1.5E-06 lb/MMBTU	2.7E-05	(h)
Benzo(k)fluoranthene**	2.2E-07 lb/MMBTU	3.9E-06	(h)
Indeno(1,2,3-cd)pyrene**	4.1E-07 lb/MMBTU	7.4E-06	(h)

- (a) The list of EPA criteria pollutants that have related National Ambient Air Quality Standards (NAAQS). VOC is not a criteria pollutant but is included here per note (e). Toxic Air Pollutants (TAPs) are defined as those in WAC 173-460. Greenhouse gas is not a criteria pollutant or TAP and is exempt from minor New Source Review requirements per WAC 173-400-110(5)(b).
- (b) Potential to Emit (PTE) estimates are based on manufacturer specifications provided with the application. The load with the highest emissions, after considering the maximum power rated for that load, was used. PM10 and PM2.5 emissions are listed as the same value. However, diesel engine particulate emissions are considered to be of size PM2.5. For modeling purposes to show compliance with NAAQS, condensable particulate was conservatively assumed to be equal to VOC. The highest summed emission factor of filterable particulate (DEEP) and VOC (after considering power rating) were used for filterable plus condensable emission totals (PM2.5 & PM10 totals). PTE includes applicable cold start “black puff” factors of 4.3 (PM & HC), and 9.0 (CO) as presented in the application (Appendix B).
- (c) Applicants estimated emissions based on fuel sulfur mass balance assuming 0.00150 weight percent sulfur fuel.

- (d) EPA's AP-42 document does not provide an emission factor for lead emissions from diesel-powered engines. Lead emissions are presumed to be negligible.
- (e) Ozone is not emitted directly into the air, but is created when its two primary components, volatile organic compounds (VOC) and oxides of nitrogen (NOx), combine in the presence of sunlight. *Final Ozone NAAQS Regulatory Impact Analysis EPA-452/R-08-003*, March 2008, Chapter 2.1.
- (f) PTE in tons per year (TPY) is based on an estimated yearly average of emissions over a rolling monthly three-year period of the listed pollutant. Other single event and unlikely scenarios were also considered. The applicant demonstrated that these scenarios were in compliance with NAAQS. An explanation in the CyrusOne application for PTE (TPY) Max and one-time ultra-worst year scenarios is repeated here. A *"theoretical maximum year"* addresses the worst-case consideration that, for fuel usage and hour limitations to be averaged over a three-year period, there is potential for emitting the three-year maximum entirely within a single year. Because maintenance would need to be conducted each year, the theoretical maximum year includes one year of hours allotted to maintenance (14 hours) plus three years of hours allotted to power outage use (72 hours) for each generator. The theoretical maximum year also includes up to 756 total cumulative generator run hours that can be used for the purposes of startup and commissioning. The theoretical maximum cumulative hours for all 2.25-MW generators in a single year would be 4,160 (3,440 hours for maintenance and power outage and 720 hours for commissioning). The theoretical maximum cumulative hours for the 750-kW generators in a single year would be 208 (172 hours for maintenance and power outage and 36 hours for commissioning). If more than 756 total cumulative generator operating hours are required for startup and commissioning in a single year, those would be counted against the annual operating runtime limit. This unlikely but possible event is considered the ultra-worst-case scenario for project related emissions from the emergency generators and was used for demonstration of compliance with the annually averaged NAAQS and Washington State TAP standards with an annual averaging period."
- (g) The DEEP ASIL is considered to be only the filterable portion of particulate as defined in this note. It is based on the cancer unit risk factor established by the California Office of Environmental Health Hazard Assessment (OEHHA) which states: "The complex and potentially variable mix of chemical species in the condensed phase and the vapor phase of diesel exhaust, required the measure of exposure related to carcinogenic risk to be specified. The most commonly used measure of exposure is atmospheric concentration of particles in $\mu\text{g}/\text{m}^3$. That measure is obtained from the mass of particles collected on a filter per volume of the air that flowed through the filter. On the basis of its relation to health studies and its general practicality, that measure was used in the diesel exhaust TAC document cancer risk assessment (OEHHA, 1998)". This is also consistent with California Code of Regulations §

93115.14 as referenced in Section 3 of this TSD. Therefore, DEEP does not include condensable particulate emissions.

(h) EPA AP-42 § 3.3 or 3.4 from: Emissions Factors and AP 42, Compilation of Air Pollutant Emission Factors.

1.2. Maximum Operation Scenarios Based on Tier 2 Compliant Engines

Cold start adjustment factors are used to approximate the additional emissions from cold engines burning off the accumulated fuel and crankcase oil on cold cylinders. Cold start factors are based on California Energy Commission tests as presented in the application. CyrusOne used one-minute cold start factors of 4.3 (PM/VOC), 9.0 (CO), and 1.0 (NO_x). These are approximately equivalent to other data centers in Quincy, which applied 10-minute cold start factors of 1.26, 1.56, and 1.0 to a 15 minute period.

CyrusOne also considered NAAQS compliance during a theoretical worst-year scenarios as explained in footnote f in Table 1.

2. Applicable Requirements

The proposal by CyrusOne qualifies as a new source of air contaminants as defined in Washington Administrative Code (WAC) 173-400-110 and WAC 173-460-040, and requires Ecology approval. The installation and operation of the CyrusOne Data Center is regulated by the requirements specified in:

- 2.1. Chapter 70.94 Revised Code of Washington (RCW), Washington Clean Air Act.
- 2.2. Chapter 173-400 Washington Administrative Code (WAC), General Regulations for Air Pollution Sources.
- 2.3. Chapter 173-460 WAC, Controls for New Sources of Toxic Air Pollutants.
- 2.4. 40 CFR Part 60 Subpart IIII and 40 CFR 63 Subpart ZZZZ* (* See section 2.4.4).

All state and federal laws, statutes, and regulations cited in this approval refer to the versions that are current on the date the final approval order is signed and issued.

2.4.1. Support for permit Approval Condition 2.1 regarding applicability of 40 CFR Part 60 Subpart IIII:

As noted in the applicability section of 40CFR1039 (part 1039.1.c), that regulation applies to non-road compression ignition (diesel) engines and (c) *The definition of nonroad engine in 40 CFR 1068.30 excludes certain engines used in stationary applications.* According to the definition in 40CFR1068.30(2)(ii): *An internal combustion engine is not a nonroad engine if it meets any of the following criteria: The engine is regulated under 40 CFR part 60, (or otherwise regulated by a federal New Source Performance Standard promulgated under section 111 of the Clean Air Act (42 U.S.C.*

7411)). Because the engines at CyrusOne are regulated under 40CFR60 subpart IIII (per 40CFR60.4200), they are not subject to 40CFR1039 requirements except as specifically required within 40CFR60.

Some emergency engines with lower power rating are required by 40CFR60 to meet 40CFR1039 Tier 4 emission levels, but not emergency engines with ratings that will be used at CyrusOne (0.750 MWe and 2.25 MWe). Instead, 40CFR60 requires the engines at CyrusOne to meet the Tier 2 emission levels of 40CFR89.112 (see section 4 with respect to add-on controls). The applicable sections of 40CFR60 for engine owners are pasted below in italics with bold emphasis on the portions requiring Tier 2 emission factors for emergency generators such as those at CyrusOne:

§60.4205 What emission standards must I meet for emergency engines if I am an owner or operator of a stationary CI internal combustion engine?

(b) Owners and operators of 2007 model year and later emergency stationary CI ICE with a displacement of less than 30 liters per cylinder that are not fire pump engines must comply with the emission standards for new nonroad CI engines in §60.4202 (see below), for all pollutants, for the same model year and maximum engine power for their 2007 model year and later emergency stationary CI ICE.

(Note: Based on information provided by the applicant, CyrusOne will use the following engines specifications: 2012 MTU Model 12V2000G85-TB rated 0.750 MWe and 2018 MTU Model 16V4000G84S rated 2.25 MWe. Based on these specifications, the 0.750 MWe engine has 23.9 liters displacement over 12 cylinders, or 1.99 liters per cylinder; the 2.25 MWe engines have 76.3 liters displacement over 16 cylinders, or 4.8 liters per cylinder. Thus, because the specified engines at CyrusOne will all have a displacement of less than 30 liters per cylinder, and are for emergency purposes only, they are required to meet §60.4202 manufacturer requirements listed below).

§60.4202 What emission standards must I meet for emergency engines if I am a stationary CI internal combustion engine manufacturer?

*(a) Stationary CI internal combustion engine manufacturers must certify their 2007 model year and later emergency stationary CI ICE with a maximum engine power **less than or equal to 2,237 KW (3,000 HP)** and a displacement of less than 10 liters per cylinder that are not fire pump engines to the emission standards specified in paragraphs (a)(1) through (2) of this section.*

(1) For engines with a maximum engine power less than 37 KW (50 HP):

(i) The certification emission standards for new nonroad CI engines for the same model year and maximum engine power in 40 CFR

89.112 and 40 CFR 89.113 for all pollutants for model year 2007 engines.

(ii) The certification emission standards for new nonroad CI engines in 40 CFR 1039.104, 40 CFR 1039.105, 40 CFR 1039.107, 40 CFR 1039.115, and table 2 to this subpart, for 2008 model year and later engines.

(2) For engines with a maximum engine power greater than or equal to 37 KW (50 HP), the certification emission standards for new nonroad CI engines for the same model year and maximum engine power in 40 CFR 89.112 and 40 CFR 89.113 for all pollutants beginning in model year 2007.

(Note: Thus, as outlined in previous note, and based on the power ratings listed in 40 CFR 60.4202(a), the 0.750 MWe and 2.25 MWe engines at CyrusOne are required to meet the applicable 40 CFR 89 Tier 2 emission standards.)

*(b) Stationary CI internal combustion engine manufacturers must certify their 2007 model year and later emergency stationary CI ICE with a maximum engine power **greater than 2,237 KW (3,000 HP)** and a displacement of less than 10 liters per cylinder that are not fire pump engines to the emission standards specified in paragraphs (b)(1) through (2) of this section.*

(1) For 2007 through 2010 model years, the emission standards in Table 1 to this subpart, for all pollutants, for the same maximum engine power.

(2) For 2011 model year and later, the certification emission standards for new nonroad CI engines for engines of the same model year and maximum engine power in 40 CFR 89.112 and 40 CFR 89.113 for all pollutants.

2.4.2. Support for permit Approval Condition 1.1 regarding applicability of 40 CFR 60.4211(f):

The emergency engine generators approved for operation by the Order are to be used solely for those purposes authorized for emergency generators under 40 CFR 60, Subpart IIII. The permit allows emergency use consistent with the hourly operation requirements described in 40 CFR 60.4211(f), except that there shall be no operation of this equipment to produce power for demand-response arrangements, peak shaving arrangements, nor to provide power as part of a financial arrangement with another entity, nor to supply power to the grid. Operating generators for uses beyond what is allowed in Approval

Condition 1.1 goes beyond the intended use of emergency generators for data center back-up power only. Approval Condition 1.1 is consistent with the provisions of other data center permits in Quincy.

2.4.3. Support for Approval Condition 8.5 regarding recordkeeping requirements describing the purpose of engine operation:

Recording the reason for operating engines (along with load rate and duration) is consistent with the provisions of other data center permits in Quincy. In order to demonstrate compliance with 40 CFR 60.4211(f), this Approval Condition requires that CyrusOne record this information. In addition to demonstrating compliance 40 CFR 60.4211(f), this condition is also required to show compliance with Approval Conditions 8.1.3. and because of its importance to Ecology and the Quincy community. Consistent with the application, which did not request extended operation at low loads, provisions for extended operation of low loads are not specified in the permit. Extended operation at low-loads is defined as operation of engines, which would cause wet stacking and the potential need for burn-off of wet-stacked engines. If the facility pursues extended operation at low loads, Ecology may require additional information from the facility.

2.4.4. Support for complying with 40 CFR 63 Subpart ZZZZ from Section 3 of TSD:

According to section 40 CFR 63 Subpart ZZZZ section 636590 part (c) and (c)(1), sources such as this facility, are required to meet the requirements of 40 CFR 60 IIII and “*no further requirements apply for such engines under this (40 CFR 63 Subpart ZZZZ) part.*”

3. Source Testing and Visual Emissions Testing

Source testing requirements and test method options outlined in Section 4 of the Approval Order requires a five-load test for PM, NOX, CO, and VOC. PM is considered to be DEEP at size PM2.5 or smaller, which tests only for the filterable particulate matter, consistent with California Code of Regulations § 93115.14 *ATCM for Stationary CI Engines – Test Methods* (measuring front half particulate only) per subsection (a)(1)(A)(1).

Ecology also includes the partial dilution probe method from 40 CFR 1065 as an option. Use of this test more closely simulates the test that manufacturers are required to use to meet NSPS requirements and will potentially reduce testing time compared to other test options. By reducing testing time, engine emissions from stack testing will be reduced.

For this permit, engine testing is determined as described in sections 3.1, 3.2, 3.3, and 3.4 of this TSD.

3.1. New Engine Stack Testing

The permit requires that CyrusOne test at least one engine from each manufacturer and each size engine from each manufacturer according to one of two options:

Option 1: the new engine shall be tested onsite as soon as possible after commissioning and before it becomes operational.

Option 2: before becoming operational onsite, the engine shall be tested at the manufacturer's testing cell if the onsite conditions are reproduced and verified as so, by the manufacturer in a letter to Ecology. The letter from the manufacturer shall verify that test conditions reproduce facility site conditions in their test cell using the same testing methods that are required for certification of the engines.

3.2. Periodic Stack Testing

Every 60 months after the first testing performed, starting with engines tested after the date of this permit, CyrusOne is required to test at least one engine, including the engine with the most operating hours.

3.3. Visual Emissions Testing

Unless otherwise approved in writing by Ecology, Approval Condition 5.3.7 for opacity is assumed to apply at all times including during potential burn-off of wet stacked engines. An alternate approval may require some type of demonstration as explained in section 2.4.3 of this TSD.

3.4. Audit Sampling

According to Condition 4.2, audit sampling per 40 CFR 60.8(g), may be required by Ecology at their discretion. Ecology will not require audit samples for test methods specifically exempted in 40 CFR 60.8(g) such as Methods, 7E, 10, 18, 25A, and 320. For non-exempted test methods, according to 40 CFR 60.8(g):

"The compliance authority responsible for the compliance test may waive the requirement to include an audit sample if they believe that an audit sample is not necessary."

Although Ecology believes that audit sampling is not necessary for certified engines, Ecology may choose at any time to require audit sampling for any stack tests conducted. Audit sampling could include, but would not necessarily be limited to, any or all of the following test methods: Methods 5, 201A, 202, or 40CFR1065.

4. Support for Best Available Control Technology Determination

As noted in Condition 2.1 of the Approval Order, each engine must meet the emission requirements of EPA Tier 2 engines. Ecology does not consider additional control equipment to be Best Available Control Technology (BACT) at CyrusOne because of the reasons outlined in this section.

BACT is defined¹ as “an emission limitation based on the maximum degree of reduction for each air pollutant subject to regulation under chapter 70.94 RCW emitted from or which results from any new or modified stationary source, which the permitting authority, on a case-by-case basis, taking into account energy, environmental, and economic impacts and other costs, determines is achievable for such source or modification through application of production processes and available methods, systems, and techniques, including fuel cleaning, clean fuels, or treatment or innovative fuel combustion techniques for control of each such pollutant. In no event shall application of the "best available control technology" result in emissions of any pollutants which will exceed the emissions allowed by any applicable standard under 40 CFR Part 60 and Part 61. If the Administrator determines that technological or economic limitations on the application of measurement methodology to a particular emissions unit would make the imposition of an emissions standard infeasible, a design, equipment, work practice, operational standard, or combination thereof, may be prescribed instead to satisfy the requirement for the application of best available control technology. Such standard shall, to the degree possible, set forth the emissions reduction achievable by implementation of such design, equipment, work practice or operation, and shall provide for compliance by means which achieve equivalent results.

For this project, Ecology is implementing the “top-down” approach for determining BACT for the proposed diesel engines. The first step in this approach is to determine, for each proposed emission unit, the most stringent control available for a similar or identical emission unit. If that review can show that this level of control is not technically or economically feasible for the proposed source (based upon the factors within the BACT definition), then the next most stringent level of control is determined and similarly evaluated. This process continues until the BACT level under consideration cannot be eliminated by any substantial or unique technical, environmental, or economic objections.² The "top-down" approach shifts the burden of proof to the applicant to justify why the proposed source is unable to apply the best technology available. The BACT analysis must be conducted for each pollutant that is subject to new source review.

The proposed diesel engines and/or cooling towers will emit the following regulated pollutants which are subject to BACT review: nitrogen oxides (NO_x), carbon monoxide (CO), volatile organic compounds (VOCs), particulate matter (PM₁₀ and PM_{2.5}), and sulfur dioxide (SO₂). BACT for toxics (tBACT) is included in Section 4.5.

4.1. BACT Analysis for NOX from Diesel Engine Exhaust

CyrusOne reviewed the following BACT information for internal combustion engines.

¹ RCW 70.94.030(7) and WAC 173-400-030(12).

² J. Craig Potter, EPA Assistant Administrator for Air and Radiation memorandum to EPA Regional Administrators, “Improving New Source Review (NSR) Implementation”, December 1, 1987.

4.1.1. BACT options for NOX

CyrusOne found that urea -based selective catalytic reduction (SCR) was the most stringent add-on control option demonstrated on diesel engines. The application of the SCR technology for NOX control was therefore considered the top-case control technology and evaluated for technical feasibility and cost-effectiveness. The most common BACT determination identified for NOX control was compliance with EPA Tier 2 standards using engine design, including exhaust gas recirculation (EGR) or fuel injection timing retard with turbochargers. Other NOX control options identified by Ecology through a literature review include selective non-catalytic reduction (SNCR), non-selective catalytic reduction (NSCR), water injection, as well as emerging technologies. Ecology reviewed these options and addressed them below.

4.1.1.1. Selective catalytic reduction

The SCR system functions by injecting a liquid reducing agent, such as urea, through a catalyst into the exhaust stream of the diesel engine. The urea reacts with the exhaust stream converting nitrogen oxides into nitrogen and water. SCR can reduce NOX emissions by approximately 90 percent.

For SCR systems to function effectively, exhaust temperatures must be high enough (about 200 to 500°C) to enable catalyst activation. For this reason, SCR control efficiencies are expected to be relatively low during the initial minutes after engine start up, especially during maintenance, testing, and storm avoidance loads. Minimal amounts of the urea-nitrogen reducing agent injected into the catalyst does not react and is emitted as ammonia. Optimal operating temperatures are needed to minimize excess ammonia (ammonia slip) and maximize NOX reduction. SCR systems are costly. Most SCR systems operate in the range of 290°C to 400°C. Platinum catalysts are needed for low temperature range applications (175°C–290°C); zeolite can be used for high temperature applications (560°C); and conventional SCRs (using vanadium pentoxide, tungsten, or titanium dioxide) are typically used for temperatures from 340°C to 400°C.

CyrusOne has evaluated the cost effectiveness of installing and operating SCR systems on each of the proposed diesel engines. Assuming no direct annual maintenance, labor, and operation costs, the analysis indicates that the use of SCR systems would cost approximately \$27,000 per ton of NOX removed from the exhaust stream each year; or higher, if taking into account California Area Resource Board (CARB) estimated operation, labor, and maintenance costs. If SCR is combined with a Tier 4 capable integrated control system, which includes SCR, as well as control technologies for other pollutants such as PM, CO, and VOC (see Section 4.3), the cost estimate would be approximately \$39,000 for NOX alone or \$32,000 per ton of combined pollutants removed per year.

Ecology concludes that while SCR is a demonstrated emission control technology for diesel engines and preferred over other NOX control alternatives described in subsection 4.1.1.3., it is not economically feasible for this project. Furthermore, although NOX includes more than just NO2, the only NOX that currently have NAAQS is NO2. Cost per ton removal of NO2 is approximately an order of magnitude more expensive than for NOX and is addressed under tBACT in Section 4.5.

Therefore, Ecology agrees with the applicant that this NOX control option can be excluded as BACT (both as SCR alone and as part of Tier 4 capable integrated control system, which includes a combination of SCR with other control technologies for other pollutants).

4.1.1.2. Combustion controls, Tier 2 compliance, and programming verification

Diesel engine manufacturers typically use proprietary combustion control methods to achieve the overall emission reductions needed to meet applicable EPA tier standards. Common general controls include fuel injection timing retard, turbocharger, a low-temperature aftercooler, use of EPA Tier-2 certified engines operated as emergency engines as defined in 40 CFR §60.4219, and compliance with the operation and maintenance restrictions of 40 CFR Part 60, Subpart IIII. Although it may lead to higher fuel consumption, injection timing retard reduces the peak flame temperature and resulting NOX emissions. While good combustion practices are a common BACT approach, for the CyrusOne Data Center engines however, a more specific approach, based on input from Ecology inspectors after inspecting similar data centers, is to obtain written verification from the engine manufacturer that each engine of the same make, model, and rated capacity installed at a facility use the same electronic Programmable System Parameters, i.e., configuration parameters, in the electronic engine control unit. These BACT options are considered further in Section 4.1.2.

4.1.1.3. Other control options

Other NOX control options listed in this subsection were considered but rejected for the reasons specified:

4.1.1.3.1. Selective non-catalytic reduction (SNCR)

This technology is similar to that of an SCR but does not use a catalyst. Initial applications of Thermal DeNOx, an ammonia based SNCR, achieved 50 percent NOX reduction for some stationary sources. This application is limited to new stationary sources because the space required to completely mix ammonia with exhaust gas needs to be part of the source design. A different version of SNCR called NOXOUT uses urea and has achieved 50–70 percent NOX reduction. Because the SNCR system does not use a catalyst, the reaction between ammonia and NOX occurs at a

higher temperature than with an SCR, making SCR applicable to more combustion sources. Currently, the preferred technology for back-end NOX control of reciprocating internal combustion engine (RICE) diesel applications appears to be SCR with a system to convert urea to ammonia.

4.1.1.3.2. Non-selective catalytic reduction (NSCR)

This technology uses a catalyst without a reagent and requires zero excess air. The catalyst causes NOX to give up its oxygen to products of incomplete combustion (PICs), CO, and hydrocarbons, causing the pollutants to destroy each other. However, if oxygen is present, the PICs will burn up without destroying the NOX. While NSCR is used on most gasoline automobiles, it is not immediately applicable to diesel engines because diesel exhaust oxygen levels vary widely depending on engine load. NSCR might be more applicable to boilers. Currently, the preferred technology for back-end NOX control of reciprocating internal combustion engine (RICE) diesel applications appears to be SCR with a system to convert urea to ammonia. See also Section 4.2.1.3 (Three-Way Catalysts).

4.1.1.3.3. Water injection

Water injection is considered a NOX formation control approach and not a back-end NOX control technology. It works by reducing the peak flame temperature and therefore reducing NOX formation. Water injection involves emulsifying the fuel with water and increasing the size of the injection system to handle the mixture. This technique has minimal effect on CO emissions but can increase hydrocarbon emissions. This technology is rejected because there is no indication that it is commercially available and/or effective for new large diesel engines.

4.1.1.3.4. Other emerging technologies

Emerging technologies include NOX adsorbers, RAPER-NOX, ozone injection, and activated carbon absorption.

- **NOX Adsorbers:** NOX adsorbing technologies (some of which are known as SCONOX or EMxGT) use a catalytic reactor method similar to SCR. SNONOX uses a regenerated catalytic bed with two materials, a precious metal oxidizing catalyst (such as platinum) and potassium carbonate. The platinum oxidizes the NO into NO₂, which can be adsorbed onto the potassium carbonate. While this technology can achieve NOX reductions up to 90 percent (similar to an SCR), it is rejected because it has significantly higher capital and operating costs than an SCR. Additionally, it requires a catalyst wash every 90 days, and has issues with diesel fuel applications, (the GT on EMxGT indicates gas turbine application). A

literature search did not reveal any indication that this technology is commercially available for stationary backup diesel generators.

- **Raper-NOX:** This technology consists of passing exhaust gas through cyanic acid crystals, causing the crystals to form isocyanic acid, which reacts with the NOX to form CO₂, nitrogen, and water. This technology is considered a form of SNCR, but questions about whether stainless steel tubing acted as a catalyst during development of this technology, would make this another form of SCR. To date, it appears this technology has never been offered commercially.
- **Ozone Injection:** Ozone injection technologies, some of which are known as LoTOx or BOC, use ozone to oxidize NO to NO₂ and further to NO₃. NO₃ is soluble in water and can be scrubbed out of the exhaust. As noted in the literature, ozone injection is a unique approach because while NOX is in attainment in many areas of the United States (including Quincy, WA), the primary reason to control NOX is that it is a precursor to ozone. Due to high additional costs associated with scrubbing, this technology is rejected.
- **Activated Carbon Absorption with Microwave Regeneration:** This technology consists of using alternating beds of activated carbon by conveying exhaust gas through one carbon bed, while regenerating the other carbon bed with microwaves. This technology appears to be successful in reducing NOX from diesel engine exhaust. However, it is not progressing to commercialization and is therefore rejected.

4.1.2. BACT determination for NOX

Ecology determines that BACT for NOX is the use of EPA Tier-2 certified engines operated as emergency engines as defined in 40 CFR§60.4219, and compliance with the operation and maintenance restrictions of 40 CFR Part 60, Subpart IIII. In addition, the source must have written verification from the engine manufacturer that each engine of the same make, model, and rated capacity installed at the facility uses the same electronic Programmable System Parameters, i.e., configuration parameters, in the electronic engine control unit. "Installed at the facility" could mean at the manufacturer or at the data farm because the engine manufacturer service technician sometimes makes the operational parameter modification/correction to the electronic engine controller at the data farm. CyrusOne will install engines consistent with this BACT determination. Ecology believes this is a reasonable approach in that this BACT requirement replaces a more general, common but related BACT requirement of "good combustion practices."

Note: Because control options for PM, CO, and VOCs, are available as discussed in BACT Section 4.2., which are less costly per ton than the Tier 4 capable integrated control system option for those pollutants, both the SCR-

only option as well as the Tier 4 capable integrated control system option are not addressed further within BACT.

4.2. BACT Analysis for PM, CO, and VOC from Diesel Engine Exhaust

The following demonstrated technologies for the control of PM, CO, and VOC emissions from the proposed diesel engines are discussed in this section:

4.2.1. BACT options for PM, CO, and VOC from diesel engine exhaust

4.2.1.1. Diesel particulate filters

These add-on devices include passive and active DPFs, depending on the method used to clean the filters (i.e., regeneration). Passive filters rely on a catalyst while active filters typically use continuous heating with a fuel burner to clean the filters. The use of DPFs to control diesel engine exhaust particulate emissions has been demonstrated in multiple engine installations worldwide. Particulate matter reductions of up to 85 percent or more have been reported. Therefore, this technology was identified as the top case control option for diesel engine exhaust particulate emissions from the proposed engines.

CyrusOne has evaluated the cost effectiveness of installing and operating catalyzed DPFs on each of the proposed diesel engines. The analysis indicates that the use of catalyzed DPFs would cost approximately \$731,000 per ton of engine exhaust particulate removed from the exhaust stream at CyrusOne each year. Catalyzed DPFs also remove CO and VOCs at costs of approximately \$65,000 and \$334,000 per ton per year respectively. If the cost effectiveness of catalyzed DPF use is evaluated using the total amount of PM, CO, and VOCs reduced, the cost estimate would be approximately \$51,000 per ton of pollutants removed per year.

These annual estimated costs (for catalyzed DPF use alone) provided by CyrusOne are conservatively low estimates that take into account installation, tax, and shipping capital costs but assume a lower bound estimate for operational, labor and maintenance costs of \$0, whereas an upper bound CARB estimate would increase the cost per ton price.

Ecology concludes that use of catalyzed DPF is not economically feasible for this project. Therefore, Ecology agrees with the applicant that this control option can be rejected as BACT.

4.2.1.2. Diesel oxidation catalysts

This method utilizes metal catalysts to oxidize carbon monoxide, particulate matter, and hydrocarbons in the diesel exhaust. Diesel oxidation catalysts (DOCs) are commercially available and reliable for

controlling particulate matter, carbon monoxide, and hydrocarbon emissions from diesel engines. While the primary pollutant controlled by DOCs is carbon monoxide, DOCs have also been demonstrated to reduce diesel engine exhaust particulate emissions, and hydrocarbon emissions.

CyrusOne has evaluated the cost effectiveness of installing and operating DOCs on each of the proposed diesel engines. The following DOC BACT cost details are provided as an example of the BACT and tBACT cost process that CyrusOne followed for engines within this application (including for SCR-only, DPF-only, and Tier 4 capable integrated control system technologies).

- CyrusOne obtained the following recent DOC equipment costs from a vendor: (\$11,500 for a stand-alone catalyzed DOC per single 2.25 MWe generator; and \$6,500 for a single 0.750 MWe generator). For forty 2.25 MWe generators and two 0.750 MWe generators, this amounts to \$472,400. According to the vendor, DOC control efficiencies for this unit are 80 percent, 70 percent, and 25 percent, for CO, HC, and filterable PM respectively.
- The subtotal becomes \$649,700 after accounting for shipping (\$26,000), WA sales tax (\$30,700), and direct on-site installation (\$126,000).
- After adding indirect installation costs, the total capital investment amounts to \$819,600. Indirect installation costs include but are not limited to startup fees, contractor fees, and performance testing.
- Annualized over 25 years and included with direct annual costs based on EPA manual EPA/452/B-02-001, the total annual cost (capital recovery and direct annual costs) is estimated to be \$85,244.
- At the control efficiencies provided from the vendor, the annual tons per year (tpy) of emissions for CO (7.9 tpy), HC (1.76 tpy), and PM (0.62 tpy) become 6.3 tpy, 1.23 tpy, and 0.16 tpy removed, respectively.
- The last step in estimating costs for a BACT analysis is to divide the total annual costs by the amount of pollutants removed (\$85,244 divided by 6.3 tpy for CO, etc.).

The corresponding annual DOC cost-effectiveness value for CO destruction alone is approximately \$13,500 per ton. If PM and hydrocarbons were individually considered, the cost-effectiveness values would be \$546,000 and \$69,000 per ton of pollutant removed annually, respectively.

These annual estimated costs (for DOC use alone) provided by CyrusOne are conservatively low estimates that take into account installation, tax, shipping, and other capital costs as mentioned above, but assume a

lower bound estimate for operational, labor and maintenance costs of \$0, whereas an upper bound CARB estimate could potentially amount to an additional \$23,000 per year of direct annual costs. This would provide a more realistic cost range of \$13,500 - \$17,100 per ton of CO removed, and a cost range of \$11,100 - \$14,100 per ton for removal of CO, PM, and HC combined.

Ecology concludes that use of DOC is not economically feasible for this project. Therefore, Ecology agrees with the applicant that these control option can be rejected as BACT.

4.2.1.3. Three-way catalysts

Three-way catalyst (TWC) technology can control CO, VOC, and NOX in gasoline engines. However, Ecology concludes that a three-way catalyst is not feasible for this project and can be rejected as BACT based on a review of the following literature:³

“The TWC catalyst, operating on the principle of non-selective catalytic reduction of NOx by CO and HC, requires that the engine is operated at a nearly stoichiometric air to- fuel (A/F) ratio... In the presence of oxygen, the three-way catalyst becomes ineffective in reducing NOx. For this reason, three-way catalysts cannot be employed for NOx control on diesel applications, which, being lean burn engines, contain high concentrations of oxygen in their exhaust gases at all operating conditions.”

4.2.2. BACT determination for PM, CO, and VOC

Ecology determines BACT for particulate matter, carbon monoxide and volatile organic compounds is restricted operation of EPA Tier-2 certified engines operated as emergency engines as defined in 40 CFR §60.4219, and compliance with the operation and maintenance restrictions of 40 CFR Part 60, Subpart IIII. CyrusOne will install engines consistent with this BACT determination.

4.3. BACT Analysis for Sulfur Dioxide from Diesel Engine Exhaust

4.3.1. BACT options for SO2

CyrusOne did not find any add-on control options commercially available and feasible for controlling sulfur dioxide emissions from diesel engines.

CyrusOne’s proposed BACT for sulfur dioxide is the use of ultra-low sulfur diesel fuel (15 ppm by weight of sulfur).

³ DieselNet, an online information service covering technical and business information for diesel engines, published by Ecopoint Inc. of Ontario, Canada (<https://www.dieselnet.com>).

4.3.2. BACT determination for SO₂

Ecology determines that BACT for sulfur dioxide is the use of ultra-low sulfur diesel fuel containing no more than 15 parts per million by weight of sulfur.

4.4. BACT Analysis for PM from Cooling Towers not Required

According to the application, “there will not be any wet mechanical-draft cooling towers used for the project.” Instead, CyrusOne will use direct evaporative cooling units to cool the data center server areas. According to the applicant, “the units use direct evaporative cooling to cool data halls, which make up most of the data center complex. The cooling units evaporate City or well water into the airstream serving the data halls, and eventually discharge that air back into the atmosphere. The main impact of the system to the surrounding environment is increased moisture/humidity. No known contaminants will be introduced into the surrounding atmosphere.” Because the cooling units are not a source of air emissions, a BACT analysis was not performed.

4.5. Best Available Control Technology for Toxics

Best Available Control Technology for Toxics (tBACT) means BACT, as applied to TAPs⁴. The procedure for determining tBACT followed the same procedure used above for determining BACT. Of the technologies CyrusOne considered for BACT, the minimum estimated costs as applied to tBACT for key TAPs (those above small quantity emission rates in WAC 173-460-150) are as follows:

- The minimum estimated costs to control diesel engine exhaust particulate (DEEP) is estimated to be \$550,000 per ton removed.
- The minimum estimated cost to control NO₂ is estimated to be \$272,000 per ton removed.
- The minimum estimated cost to control CO is estimated to be \$13,500 per ton removed.
- The minimum estimated costs to control acrolein, which could be treated with the VOC treatment listed under BACT, are estimated to be greater than approximately \$860 million per ton.
- The minimum estimated costs to control benzene, which could be treated with the VOC treatment listed under BACT, are estimated to be greater than approximately \$8 million per ton.
- The minimum estimated costs to control naphthalene, which could be treated with the VOC treatment listed under BACT, are estimated to be greater than approximately \$52 million per ton.

Under state rules, tBACT is required for all toxic air pollutants for which the increase in emissions will exceed de minimis emission values as found in WAC 173-460-150.

⁴ WAC 173-460-020.

Based on the information presented in this TSD, Ecology has determined that Table 4.5 represents tBACT for the proposed project.

Table 4.5.: tBACT Determination

Toxic Air Pollutant	tBACT
CO	Compliance with the CO BACT requirement
NO2	Compliance with the NOx BACT requirement
Diesel Engine Exhaust, Particulate	Compliance with the PM BACT requirement
Propylene	Compliance with the VOC BACT requirement
Sulfur dioxide	Compliance with the SO2 BACT requirement
Benzene	Compliance with the VOC BACT requirement
Xylenes	Compliance with the VOC BACT requirement
Napthalene	Compliance with the VOC BACT requirement
Formaldehyde	Compliance with the VOC BACT requirement
1,3 Butadiene	Compliance with the VOC BACT requirement
Acrolein	Compliance with the VOC BACT requirement
Benzo(b)fluoranthene	Compliance with the VOC BACT requirement
Dibenz(a,h)anthracene	Compliance with the VOC BACT requirement
Benzo(a)Pyrene	Compliance with the VOC BACT requirement

5. Ambient Air Modeling

Ambient air quality impacts at and beyond the property boundary were modeled using EPA’s AERMOD dispersion model, with EPA’s PRIME algorithm for building downwash. AERMOD modeling results are presented in Table 5.

The AERMOD model used the following data and assumptions:

- 5.1.** Five years of sequential hourly meteorological data from Moses Lake Airport were used. Twice-daily upper air data from Spokane were used to define mixing heights. The five years of data range from January 1, 2012, through December 31, 2016.
- 5.2.** The AMS/EPA Regulatory Model Terrain Pre-processor (AERMAP) was used to obtain height scale, receptor base elevation, and to develop receptor grids with terrain effects. For area topography required for AERMAP, Digital topographical data (in the form of Digital Elevation Model files) were obtained from www.webgis.com.
- 5.3.** Each of the 2.25 MWe generators was modeled with stack heights of 35 feet above local ground, and with and vertical stack diameters 18-inch. The 0.750 MWe generators were modeled at 25 feet above local ground, and 12 inches diameter.
- 5.4.** The data center buildings, in addition to the individual generator enclosures were included to account for building downwash.
- 5.5.** The receptor grid for the AERMOD modeling was established using a 12.5-meter grid spacing along the facility boundary extending to a distance of 150 meters from the nearest emission source. A grid spacing of 25 meters was used for distances of 150 meters to 400 meters. A grid spacing of 50 meters was used for distances from 400 meters to 900 meters. A grid spacing of 100 meters was used for distances from 900 meters to 2,000 meters. A grid spacing of 300 meters was used for distances from 2,000 meters to 4,500 meters. A grid spacing of 600 meters was used for distances beyond 4,500 meters from the boundary.
- 5.6.** The stack temperature and stack exhaust velocity at each generator stack were set to values corresponding to the engine loads for each type of testing and power outage. CyrusOne deviated from actual loads in a way that most likely overestimates actual emissions. As described in the application: “The modeling setup for short-term impacts at full-variable load included load-specific stack parameters (i.e., flow rate and exhaust exit temperature), which correspond to the characteristic worst-case emission load of each pollutant... The stack parameters setup for long-term impacts conservatively used the vendor-reported load-specific exhaust flow rate and temperature that would result in the worst-case dispersion conditions (i.e., the load condition with the lowest reported exhaust temperature and velocity).”
- 5.7.** Annual NO₂ concentrations at and beyond the facility boundary were modeled using the Plume Volume Molar Ratio Method (PVMRM) module, with default concentrations of 49 parts per billion (ppb) of background ozone, and an equilibrium NO₂ to NO_X ambient ratio of 90 percent.
- 5.8.** AERMOD modeling results in the application show the highest one-hour NO₂ impact occur within the westside of the facility boundary. CyrusOne used a stochastic Monte Carlo statistical package to evaluate the eighth highest daily one-hour NO₂ impacts caused by randomly occurring emissions distributed throughout the data center. As described in the application: “the script iteratively tests a thousand combinations of results from all the generator runtime scenarios, wind directions,

and wind speeds to estimate the probability, at any given receptor location, that the NAAQS standard will be violated. For the one-hour NO₂ NAAQS analysis, the script estimates the 98th-percentile concentration at each individual receptor location within the modeling domain.” The stochastic Monte Carlo analysis considered conservatively high occurrences of runtime events as described below:

- 5.8.1.** Runtime scenarios were ranked, based on worst-case potential facility emissions, The worst-case scenario was assumed to occur when all 42 generators activate concurrently, such as during a power-outage. Because the next worst-case scenarios were assumed to be during monthly maintenance or load bank testing which may occur on any generator throughout the facility, CyrusOne looked at four representative AERMOD runs at different facility locations.
- 5.8.2.** CyrusOne analyzed these scenarios by post-processing the first-highest impact of these AERMOD runs using Ecology’s Monte Carlo script. The script estimated the 98th-percentile impact value at every receptor location within the modeling domain and found the highest impact of 139 ug/m³ (including local background emission impacts). Ecology modelers found a similar result (139.6 ug/m³). Ecology modelers also used recent one-year Quincy background monitoring data of approximately 43.1 ug/m³. After adding this regional specific background impact, the total NO₂ impact is estimated by Ecology to be 182.7 ug/m³ as shown in Table 5.
- 5.9.** AERMOD Meteorological Pre-processor (AERMET) was used to estimate boundary layer parameters for use in AERMOD.
- 5.10.** AERSURFACE was used to determine the percentage of land use type around the facility based on albedo, Bowen ratio, and surface roughness parameters.

Except for DEEP and NO₂, which are predicted to exceed their acceptable source impact levels (ASILs), AERMOD model results show that no NAAQS or ASIL will be exceeded at or beyond the property boundary. The modeling results as listed in the application are provided in Table 5:

Table 5. AERMOD Modeling Results

Particulate Matter (PM10) Modeling Files: PM10_24HR_PO3.ADI

Criteria Pollutant	Standards in $\mu\text{g}/\text{m}^3$ NAAQS(a)		Maximum Applicable Ambient Impact Concentration ($\mu\text{g}/\text{m}^3$)	Local Background Concentrations ($\mu\text{g}/\text{m}^3$) (b)	Regional Background Concentrations ($\mu\text{g}/\text{m}^3$) (b)	Maximum Ambient Impact Concentration Added to Background ($\mu\text{g}/\text{m}^3$) (If Available)
	Primary	Secondary				
1st-Highest 24-hour average	150	150	66	19	62	147

Particulate Matter (PM2.5): Modeling Files: PM25_ANN.ADI; PM25_24HR_MT.ADI

Criteria Pollutant	Standards in $\mu\text{g}/\text{m}^3$ NAAQS(a)		Maximum Applicable Ambient Impact Concentration ($\mu\text{g}/\text{m}^3$)	Local Background Concentrations ($\mu\text{g}/\text{m}^3$) (b)	Regional Background Concentrations ($\mu\text{g}/\text{m}^3$) (b)	Maximum Ambient Impact Concentration Added to Background ($\mu\text{g}/\text{m}^3$) (If Available)
	Primary	Secondary				
Annual average	12	15	2.3	0.6	6.5	9.4
24-hr: 5th highest modeled impacts. (Simulation impacts from 4th highest day)	35	35	11	Negligible	21	32

Carbon Monoxide (CO): Modeling File: CO_1HR8HR.ADI

Criteria Pollutant	Standards in $\mu\text{g}/\text{m}^3$ NAAQS(a)		Maximum Applicable Ambient Impact Concentration ($\mu\text{g}/\text{m}^3$)	Local Background Concentrations ($\mu\text{g}/\text{m}^3$) (b)	Regional Background Concentrations ($\mu\text{g}/\text{m}^3$) (b)	Maximum Ambient Impact Concentration Added to Background ($\mu\text{g}/\text{m}^3$) (If Available)
	Primary	Secondary				
8-hour average	10,000	N/A	4,388 (c)	Negligible	3,308	8,196 (c)
1-hour average	40,000	N/A	7,490 (c)	Negligible	5,776	13,266 (c)

Nitrogen Oxides (NO₂): Modeling Files: NO₂_ANN.ADI; NO₂_PO.ADI; NO₂_MT1.ADI; NO₂_MT2.ADI.ADI; NO₂_MT3.ADI; NO₂_MT4.ADI. Script input files/source group: MAXDAILY_APO_NO2.DAT/(APO); MAXDAILY_AMT1_NO2.DAT/(AMT1); MAXDAILY_AMT2_NO2.DAT/(AMT2); MAXDAILY_AMT3_NO2.DAT/(AMT3); MAXDAILY_AMT4_NO2.DAT/(AMT4)

Criteria Pollutant	Standards in $\mu\text{g}/\text{m}^3$ NAAQS(a)		Maximum Applicable Ambient Impact Concentration ($\mu\text{g}/\text{m}^3$)	Local Background Concentrations ($\mu\text{g}/\text{m}^3$) (b)	Regional Background Concentrations ($\mu\text{g}/\text{m}^3$) (b)	Maximum Ambient Impact Concentration Added to Background ($\mu\text{g}/\text{m}^3$) (If Available)
	Primary	Secondary				
Annual average	100	100	34	3	2.8	39
1-hour average	188	N/A	139.6 (modeled + local background)	43.1	182.7	

Sulfur Dioxide (SO₂): Modeling File: SO₂_1HR3HR.ADI

Criteria Pollutant	Standards in µg/m ³ NAAQS(a)		Maximum Applicable Ambient Impact Concentration (µg/m ³)	Local Background Concentrations (µg/m ³) (b)	Regional Background Concentrations (µg/m ³) (b)	Maximum Ambient Impact Concentration Added to Background (µg/m ³) (If Available)
	Primary	Secondary				
3-hour average	N/A	1,300	8.0	Negligible	2.1	10
1-hour average	200	N/A	7.8	Negligible	2.6	10

Toxic Air Pollutant

Toxic Air Pollutant	Modeling Files	ASIL (µg/m ³)	Averaging Period	1st-Highest Ambient Concentration (µg/m ³)
DEEP	ncDPM_ANN.ADI	0.00333	Annual average	0.660
NO ₂	NO ₂ _1HR_ASIL.ADI	470	1-hour average	1,446
CO	CO_1HR8HR.ADI	23,000	1-hour average	7,490
Acrolein	ACR_1HR24HR.ADI	0.06	24-hour average	0.024
Benzene	Derived from: ncDPM_ANN.ADI	0.0345	Annual Average	0.020
1,3-Butadiene		0.00588	Annual Average	0.00099
Naphthalene		0.0294	Annual Average	0.0033

Notes:

N/A = not applicable and/or not provided

µg/m³ = Micrograms per cubic meter.

ppm = Parts per million.

ASIL = Acceptable source impact level.

DEEP = Diesel engine exhaust, particulate

- (a) Ecology interprets compliance with the National Ambient Air Quality Standards (NAAQS) as demonstrating compliance with the Washington Ambient Air Quality Standards (WAAQS).
- (b) Regional background is based on 1-year of Quincy monitoring. Local background concentrations took into account other nearby data centers and the Con Agra facility.
- (c) For CO (NAAQS) modeling, CyrusOne used a lower stack exit velocity (13.58 m/s) than what was used for the other pollutants (53.06 m/s). Because a lower exit velocity generally would cause higher modeled impacts, actual CO impacts are assumed to be less than those stated in this table.

CyrusOne has demonstrated compliance with the NAAQS for criteria pollutants and has demonstrated compliance with ASILs for TAPs (except for DEEP and NO₂). As required by WAC 173-460-090, emissions of DEEP and NO₂ were further evaluated, and a summary of that evaluation is presented in the following section of this document.

Update June 2024

Modeling was submitted for the change in the two 750kW generators and reviewed by Beth Friedman (Ecology HQ). Here is her emailed response on May 30th, 2024, to the review: “We reviewed the modeling files and proposed emission changes and didn’t identify any concerns with the modeling or results. Let me know if you have any other questions about the modeling.”

6. Second Tier Review for Diesel Engine Exhaust Particulate

Proposed emissions of DEEP and NO₂ from the 42 CyrusOne engines exceed the TAPs regulatory Tier 2 trigger levels (or ASILs, as defined in Section 5 Table 5). A second tier review was required for DEEP and NO₂ in accordance with WAC 173-460-090, and CyrusOne was required to prepare a health impact assessment (HIA). The HIA presents an evaluation of both noncancer hazards and increased cancer risk attributable to CyrusOne’s increased emissions of all identified carcinogenic compounds. Pollutants evaluated in the HIA included: DEEP, NO₂, 1,3-butadiene, naphthalene, carbon monoxide, benzene, acrolein, and numerous others. CyrusOne also reported the DEEP and NO₂ cumulative risks associated with CyrusOne and prevailing sources in their HIA document based on a cumulative modeling approach. The CyrusOne cumulative risk study is based on proposed generators, nearby existing permitted

sources, and other background sources including highways and railroads. Ecology concluded that the applicant has satisfied all requirements of a second-tier analysis.

7. Conclusion

Based on the above analysis, Ecology concludes that operation of the 42 generators will not have an adverse impact on air quality. Ecology finds that this project has satisfied all NOC requirements including those regarding second tier analysis for DEEP and NO₂.

Update June 2024

Based on the proposed change and modeling results, Ecology will amend the Approval Order to include the two alternate 750kW generators.

8. Response to Comments

6/13/19 Verbal comments received from the public hearing:

My name is Danna DalPorto. I live at 16651 Road 3 NW in Quincy. I am affiliated with a group of people that is called MYTAPN, which is kind of weird, but it says Microsoft Yes Toxic Air Pollution No. So, our issue is we are not against industry, we have no problem with data centers, but we do have some concern[s] about our air quality. I'm a regular attendee of these data center development meetings not because I dislike technology or that I dislike industry. I am here because as a Quincy resident for 39 years I care about the residents of my town and I want to learn about any developments that emit hazardous materials into the air we breathe. I can see the pink diesel plume over town during the frequent inversions that we have here in the summer. As is stated on page 3 of the HIA Recommendation, two toxic air pollutants exceed the ASIL: diesel particulates and NO₂. I always find it instructive that Ecology continues to blame the elevated diesel particulates on the locomotives. My point is the trains have been in Quincy for many years. Ecology's job is to monitor diesel no matter the source. And to me, Ecology is permitting a diesel source on top of those elevated numbers that were already here. We need to focus on the total effect on the public no matter what the source. Returning to the HIA document, Ecology reports that approximately 3500 people live in an area in which DEEP exceeds the ASIL and levels of NO₂ exceed the ASIL at 71 residential parcels affecting 200 residents. Those 3700 people represent a very large percentage of the entire Quincy population; we are not that big. And those include students at Mountain View School, Monument School, as well as the Quincy Valley Medical Center, and everybody in between. I hear these numbers at every meeting but Ecology continues to say that everything is okay and almost seems to welcome more industry to locate here. It bothers me. I will have additional comments, I understand that I can add to my comments from tonight by going on the website so I have until Monday to do that and I will. Based on the conversations I've had with people here tonight I will have additional things to say. Thank you for letting me speak.

Ecology's response:

Thank you for your comments. Please see our responses to your related written comments below.

6/16/19 Written comments received from eComments:

My name is Danna Dal Porto, 16651 Road 3 NW, Quincy, WA. I am a regular attendee of these data center development meetings, not because I dislike technology or that I dislike industry but I am here as a 39 year Quincy resident concerned about my community. I want to learn about developments that emit hazardous material into the air we breathe. From my house in the country I can see the pink cloud of diesel over town during one of the frequent weather inversions. The diesel cloud is over Quincy because of polluting industry, permitted by the Washington State Department of Ecology to build in this valley, and that diesel cloud negatively affects all people's health that live and work here.

Ecology's response:

With the exception of start-up, diesel engine exhaust should not be visible. If you see a pink cloud, please take a picture and report it to us at 1-800-OILS-911. During regular business hours, you can call Ecology's Eastern Regional Office at 509-329-3400.

As stated on page 3 of the CyrusOne Health Impact Assessment Review (HIA), two toxic air pollutants exceed the ASIL in the proposed CyrusOne facility: diesel particulates and NO2. I always find it instructive that Ecology continues to blame elevated diesel particles in their studies in Quincy on the "locomotives". This irritates me because the trains have been going through Quincy for many years and Ecology is allowing diesel particulate from industry to be added to the already elevated diesel numbers. Ecology's job is to monitor diesel, no matter the source. Ecology needs to focus on the total effect of diesel on the public, no matter the source.

Ecology's response:

In accordance with [WAC 173-400-113](#) *New sources in attainment or unclassifiable areas - Review for compliance with regulations*: "The permitting authority...shall issue an order of approval if it determines that the proposed project satisfies the legal requirements."

When evaluating ambient air quality impacts from a new source of air pollution, we consider the "total effect" of air pollutants in the following ways:

- 1) As part of the health impact assessment under WAC 173-460-090, we evaluate the increase in diesel particle exposure related to the new source (e.g., CyrusOne's engines) and consider the "background" exposure to diesel particles. Although the rule does not specify how "background" exposures factor into regulatory decisions, we use a cumulative risk level of 100 in one

million in Quincy, WA as a cap above which additional methods (e.g., more than BACT/tBACT) for reducing air pollution impacts would be considered/required before permitting a new source of air pollution. In the case of CyrusOne's health impact assessment, the maximum cumulatively impacted residential receptor is located near the rail line; therefore, locomotives produce a larger proportion of diesel engine particles at that location compared to other sources. The total cancer risk from diesel particulate exposure at this location is about 50 in one million.

- 2) Under WAC 173-400-113, Ecology cannot permit a new source of air pollution if that source contributes to a NAAQS violation. In this manner, we consider the existing air pollution levels when determining if the new emissions added to the existing emissions causes a NAAQS violation.

Returning to the HIA, Ecology reports that approximately 3,500 people live in an area in which DEEP exceeds the ASIL. And, NO₂ exceeds the ASIL at 71 residential parcels affecting 200 residents. Please note that the number of residents affected by NO₂ is based on numbers provided by Ecology from the U.S. Census Bureau, 2010. Those 3,700 people represent almost 50% (49.26%) of the total population of Quincy. When I called to ask today, the Quincy City Hall lists the population of Quincy at 7,510 people tabulated in 2018. According to the CyrusOne HIA, toxic air affects all the children at Mountain View School (462 children K-3), Monument School (612 children 4-7), Quincy Valley School (73 children K-8) as well as the Quincy Valley Medical Center. The health of everyone in between is affected as well. The 3,700 people affected in this HIA are just from the modeling for just a single data center, CyrusOne. Quincy has many, many, many data centers with a cloud of toxic material over the entire city.

Ecology's response:

Exceedance of acceptable source impact levels alone does not necessarily indicate unacceptable health risks. Under state law, new sources may satisfy toxic air pollutants requirements by conducting a relatively simple Tier I analysis if they can certify that emissions of those toxic air pollutants will be below certain Washington State acceptable source impact levels (ASILs). WAC 173-460-080. If modeling shows an exceedance of an acceptable source impact levels, however, the source can still qualify for permitting by preparing a health impact assessment demonstrating to Ecology's satisfaction that the health risks from the source's projected emissions of toxic air pollutants are within acceptable limits (Tier 2 analysis). WAC 173-460-080, -090.

The health impact assessment for the CyrusOne project includes emissions from several nearby sources including allowable emissions from four other data centers, as well as emission estimates from State Route 281 and 28, and the railroad. The analysis includes these sources because they are located within the

area where analyses estimate the diesel engine exhaust particulates (DEEP) to exceed the ASIL.

The purpose of the Health Impact Assessment is to provide a close look at the nature of the expected health impacts to inform the permitting process. Health impact assessments do not need to consider sources where emissions are below the ASIL. The Health Impact Assessment for this project provides detailed assessment of both the long and short-term health risks posed by the project. Ecology concluded that these risks, calculated in detail using conservative assumptions, are still below acceptable thresholds.

Ecology has taught me that air quality in Seattle can be very bad. I suspect that if 50% of the people in Seattle were affected by a permitted industry to spill toxic air over the city, Seattle residents would be pretty unhappy. An important point to make is that most of these Quincy people are low-income, minority citizens. This is an example of environmental injustice and I am very sad that my State is allowing and permitting this toxic air to accumulate over the residents of Quincy.

I hear these sad toxic air emission numbers at every Ecology permitting meeting but Ecology continues to say that everything is "OK" and Ecology almost seems to welcome more industry to locate here. It bothers me.

Ecology's response:

Please see responses above.

The Environmental Protection Agency (EPA) defines environmental justice as "the fair treatment and meaningful involvement of all people regardless of race, color, national origin, or income with respect to the development, implementation and enforcement of environmental laws, regulations and policies." We are aware that the Quincy community has a significant Hispanic population, which is why we are diligent to conduct outreach about the data centers in Spanish and have translators available at our public meetings.

I have a specific complaint about the language in the CyrusOne HIA. In the 10 plus years I have been following and learning about air quality issues, I have become familiar with several of the terms and their acronyms. I understand ASIL, DEEP, NO2 and others. Specific segments of the CyrusOne HIA contained many new benchmarks and terms to discuss air quality. I have never seen or worked with CEHHA [sic], RfC, REL, URF or AEGLS. This is pretty technical language easily understood by Ecology and industry but not easy for me to read or understand. No data was readily available to compare or contrast these terms or to compare or contrast the data in these charts. My understanding is that the responsibility of Ecology is to make presentations in a manner easily understood by the public. I will concede that air quality and the rules surrounding the permitting of data centers is very technical stuff. However, adding to or drastically changing the language of documents as has happened in the CyrusOne HIA is a very wide stretch for most of the public, certainly for me. I was not impressed with this

insider jargon and I request that common terms be used for data permitting documents so the permits can be understood by regular citizens.

Ecology's response:

See page 4 of Ecology's Health Impact Assessment (HIA) Recommendation for references to the following acronyms and how they are used.

OEHHA: California EPA's Office of Environmental Health Hazard Assessment

RfC: Reference concentration

REL: Reference exposure level

URF: Unit risk factor

AEGs: Acute exposure guideline levels

These terms are values used to estimate the cancer risk and non-cancer hazard related to exposure to toxic air pollutants.

I am requesting a map of DEEP and NO2 emissions that goes over all sections of Quincy. The maps presented in the CyrusOne meeting were limited to the west side of town. I want maps covering the entire community, East to West. I want all schools identified (including the Quincy Valley School and the new high school), the Senior Center, the two medical facilities and Quincy City Hall.

Ecology's response:

A current map showing overlapping plumes from east- and west-side Quincy data centers does not exist. The Diesel Engine Exhaust Particulate Matter Health Risk Assessment Report that Landau Associates wrote in 2018, includes a Quincy-wide map of the potential-to-emit DEEP concentrations (shown in Figure 7). However, this map does not include the CyrusOne data center.

Ecology did not require Landau Associates to include emissions from eastside data centers as part of the second tier review health impact assessment because:

- We focused our review on the area of town impacted by the proposed project at levels above the ASIL.
- Previous experience with permitting data centers in Quincy has shown us that the impacts of east side data centers on the annual average concentrations of diesel particulate matter on the west side of town are minimal.
- Separate electrical feeder lines serve each side of town according to Grant PUD. Therefore, system-wide power outages affecting east and west sides of town are expected to be unlikely.

There was a large map on display at the CyrusOne public hearing that identified all the data centers and the number of diesel generators at each facility. I want a copy of that map.

Ecology's response:

To request documents, you need to file a public records request through Ecology's public records request process. The Washington Department of Ecology adopted amendments to Chapter 173-03 WAC Public Records on November 15, 2017. [WAC 173-003-060](#) now requires people to direct all public record requests to the agency public records officer at the following email address or mailing address:

Email address: RecordsOfficer@ecy.wa.gov

Mail: Public Records Officer
WA Dept. of Ecology
PO Box 47600
Olympia WA 98504-7600

Ecology has had an air monitoring unit located in Quincy. I want the results from that unit. I have requested information on that monitor in the past with no results. I want to know how to interpret that information on the report. During the high smoke days from wildfires, I want to be able to check on air quality.

Ecology's response:

Ecology has an air quality monitor in Quincy located at 330 3rd Avenue. The monitor records wind speed and direction, temperature, and particulate matter. You can access the data from the site at: https://fortress.wa.gov/ecy/enviwa/StationInfo.aspx?ST_ID=194. The website includes the current Washington Air Quality Advisory value for the site and provides links that will help you understand the value.

To request records beyond the information provided on the monitoring website, you would need to make a public records request. See the response above for instructions on submitting a records request to Ecology.

6/17/24 Written comment received from eComments:

Instead of using diesel generators for an emergency energy supply why is the applicant not using a Battery Energy Storage System (BESS)? The BESS should be charged using renewable energy. I would think that Ecology would require the use of BESS as not just a viable alternative, but a preferred alternative. Other data centers are using BESS as a replacement of diesel-powered backup.

[\(https://batteriesnews.com/soft-delivers-battery-energy-storage-system-bess-replacement-diesel-powered-backup-at-microsoft-data-center/\)](https://batteriesnews.com/soft-delivers-battery-energy-storage-system-bess-replacement-diesel-powered-backup-at-microsoft-data-center/)

Ecology's Response:

Ecology does not have the authority to define the equipment needs of a facility, but we determine if their proposed equipment, and therefore emissions controls, meet the Federal and State standards and regulations. For the case of proposed battery backup system, this would be an alternate equipment option that may or may not meet their needs, but Ecology cannot require this type of system as an alternative.

[End of TSD for CyrusOne Data Center]